BLOW OFF / FLUSHING ASSEMBLY

FOR USE WITH 2" SERVICE ASSEMBLY




Date: December 14, 2006

January 9, 2007

Effective Date:

Drawn by: JSWilliams Revised by: JSWilliams

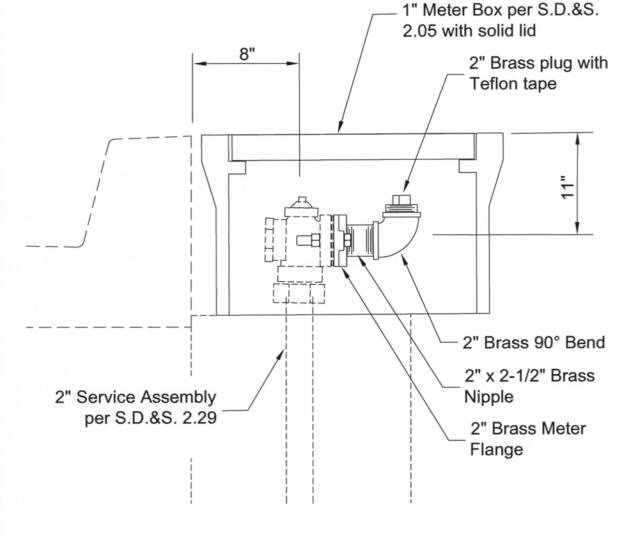

- 1. Blow Off / Flushing Attachment shall be installed where specified on plan or as directed by City Engineer. 2" Service Assembly per S.D.&S. 2.29 shall be considered as a part of Blow Off / Flushing Assembly unless specifically noted.
- 2. Install a 1" Meter Box with solid lid per S.D.&S. 2.05, set level or flush with sidewalk and centered on assembly.



City of Glendora
Public Works Department
STANDARD DESIGNS & SPECIFICATIONS

Adopted for use on Public and Private Improvements

S.D.& S. NO.

Page 1 of 1