
## **SEWER LATERAL**



- 1. Lateral shall be 6" Sch. 40 PVC or ABS, Ductile Iron Sewer Pipe or Double Strength VCP from mainline to clean out.
- 2. 6" Wye shall be installed at property line. Cleanout shall be raised to grade and plugged.
- 3. The Los Angeles County Code, Title 20, Utilities, requires that all saddle connections to the mainline sewer shall be installed by the County Department of Public Works. A copy of the L.A. Co. Department of Public Works "Instructions to sewer contractors for obtaining sewer saddle installation permits" is available at the Public Works counter for review.
- State of California, Occupational Safety and Health Administration (OSHA) permit must be available at all excavation sites where trench is 5 feet or more in depth.
- 5. The property owner served by the lateral shall be responsible for all repairs to the lateral and all damages caused by root intrusion into the lateral, including but not limited to damage to public and private property.



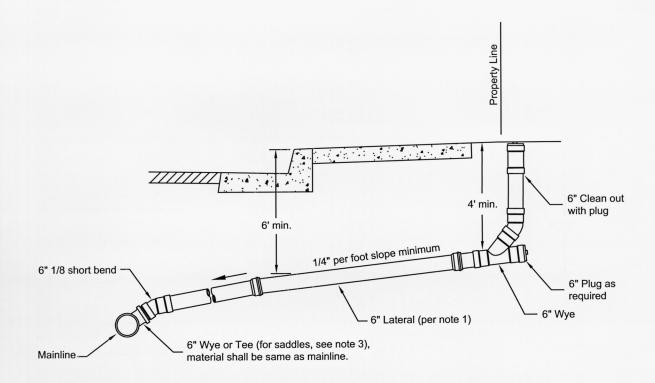

## City of Glendora Public Works Department STANDARD DESIGNS & SPECIFICATIONS

Adopted for use on Public and Private Improvements

S.D.& S. NO.

Page 1 of 1